


ACM-ECB Specifications

The ACM should be mounted on the sub panel behind the instrument panel. The Fused and Electronic Circuit Breaker versions are the same size and mounting. The ACM module should be mounted to the sub panel using four 10-32 screws and nut plates.

ACM Mounting

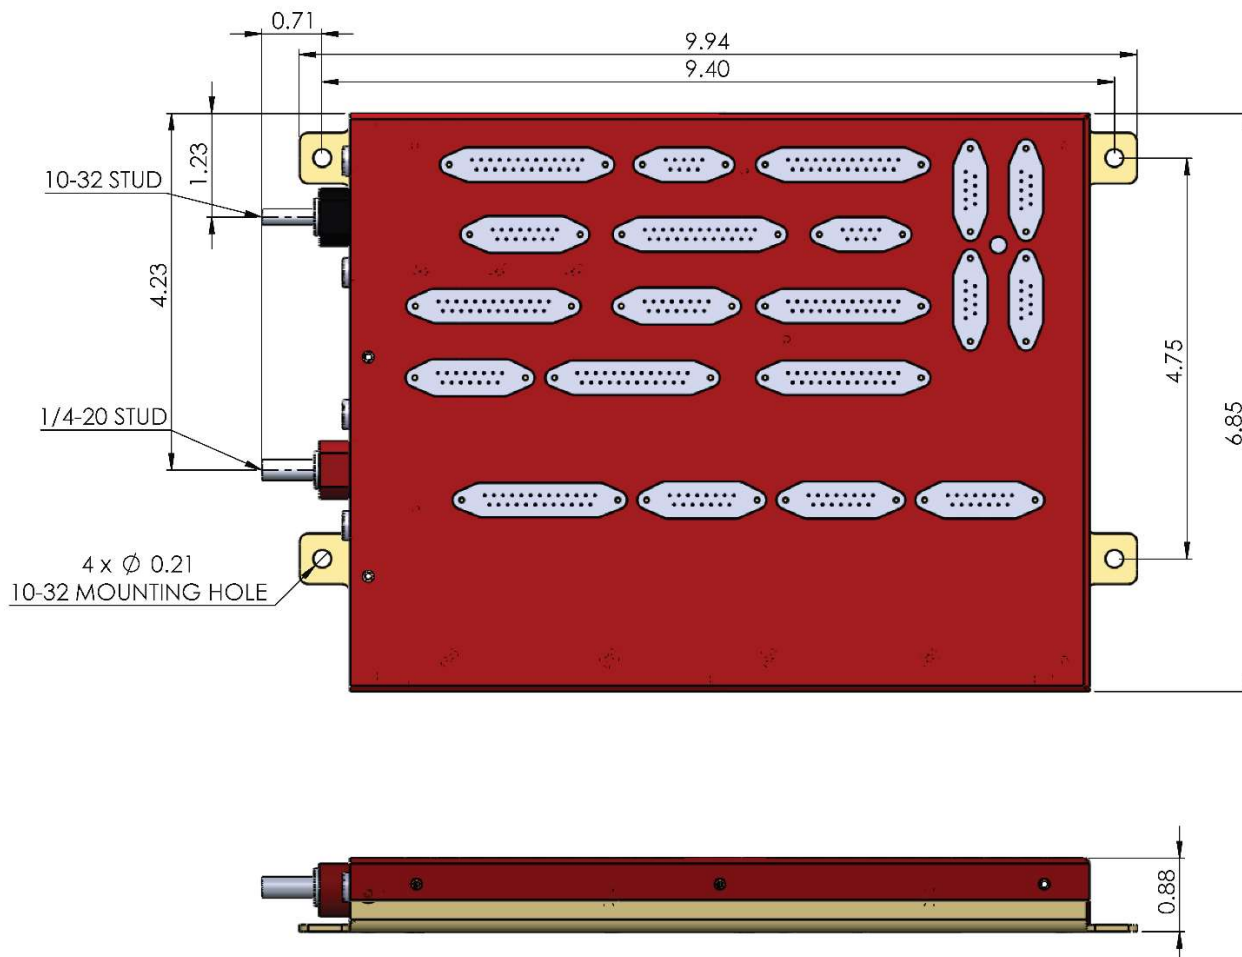

Do not over-torque the power terminal nuts, they are soft copper and will break if over-torqued.

Red Main Power Terminal Nut Torque: 28 in-lbs

Black Main Ground Terminal Nut Torque: 19 in-lbs

Component Weights

ACM-ECB Module	2 Lbs	3 oz
Master Switch Module		5 oz
Lower Switch Module		7 oz